

Lloyd's Test Inspection certificate spring operated safety valve

Customer	: ASE	ASE Certificate nr.	: 7200**** - 4488
P.O.Number	: .	Date	: 19-3-2020
		Tag NR.	: PSV88

Valve information

Manufacturer	: HEROSE	Body mat.	: CC491K
Type number	: 06388.1006.0000	Disc mat.	: PTFE
Serial number	: 3977132	Seat mat.	: 1.4301
Seat diam. Do	: 10,5		
Inlet DN/PN	: 1"		
Outlet DN/PN	: 1"		
Bellow	: N		


Manometer Info

Manometer number	: 88866
------------------	---------


Spring information

Spring nr. / Code	: 55345.0237.0767	Set Pressure	: 88 Bar(g)
De	: 21,5	Test Medium	: AIR
D	: 3,8		
N	: 8,3		
Lo	: 60		

	OLD	NEW
Length Adjustment screw (H)	: 10,25	: 10,56

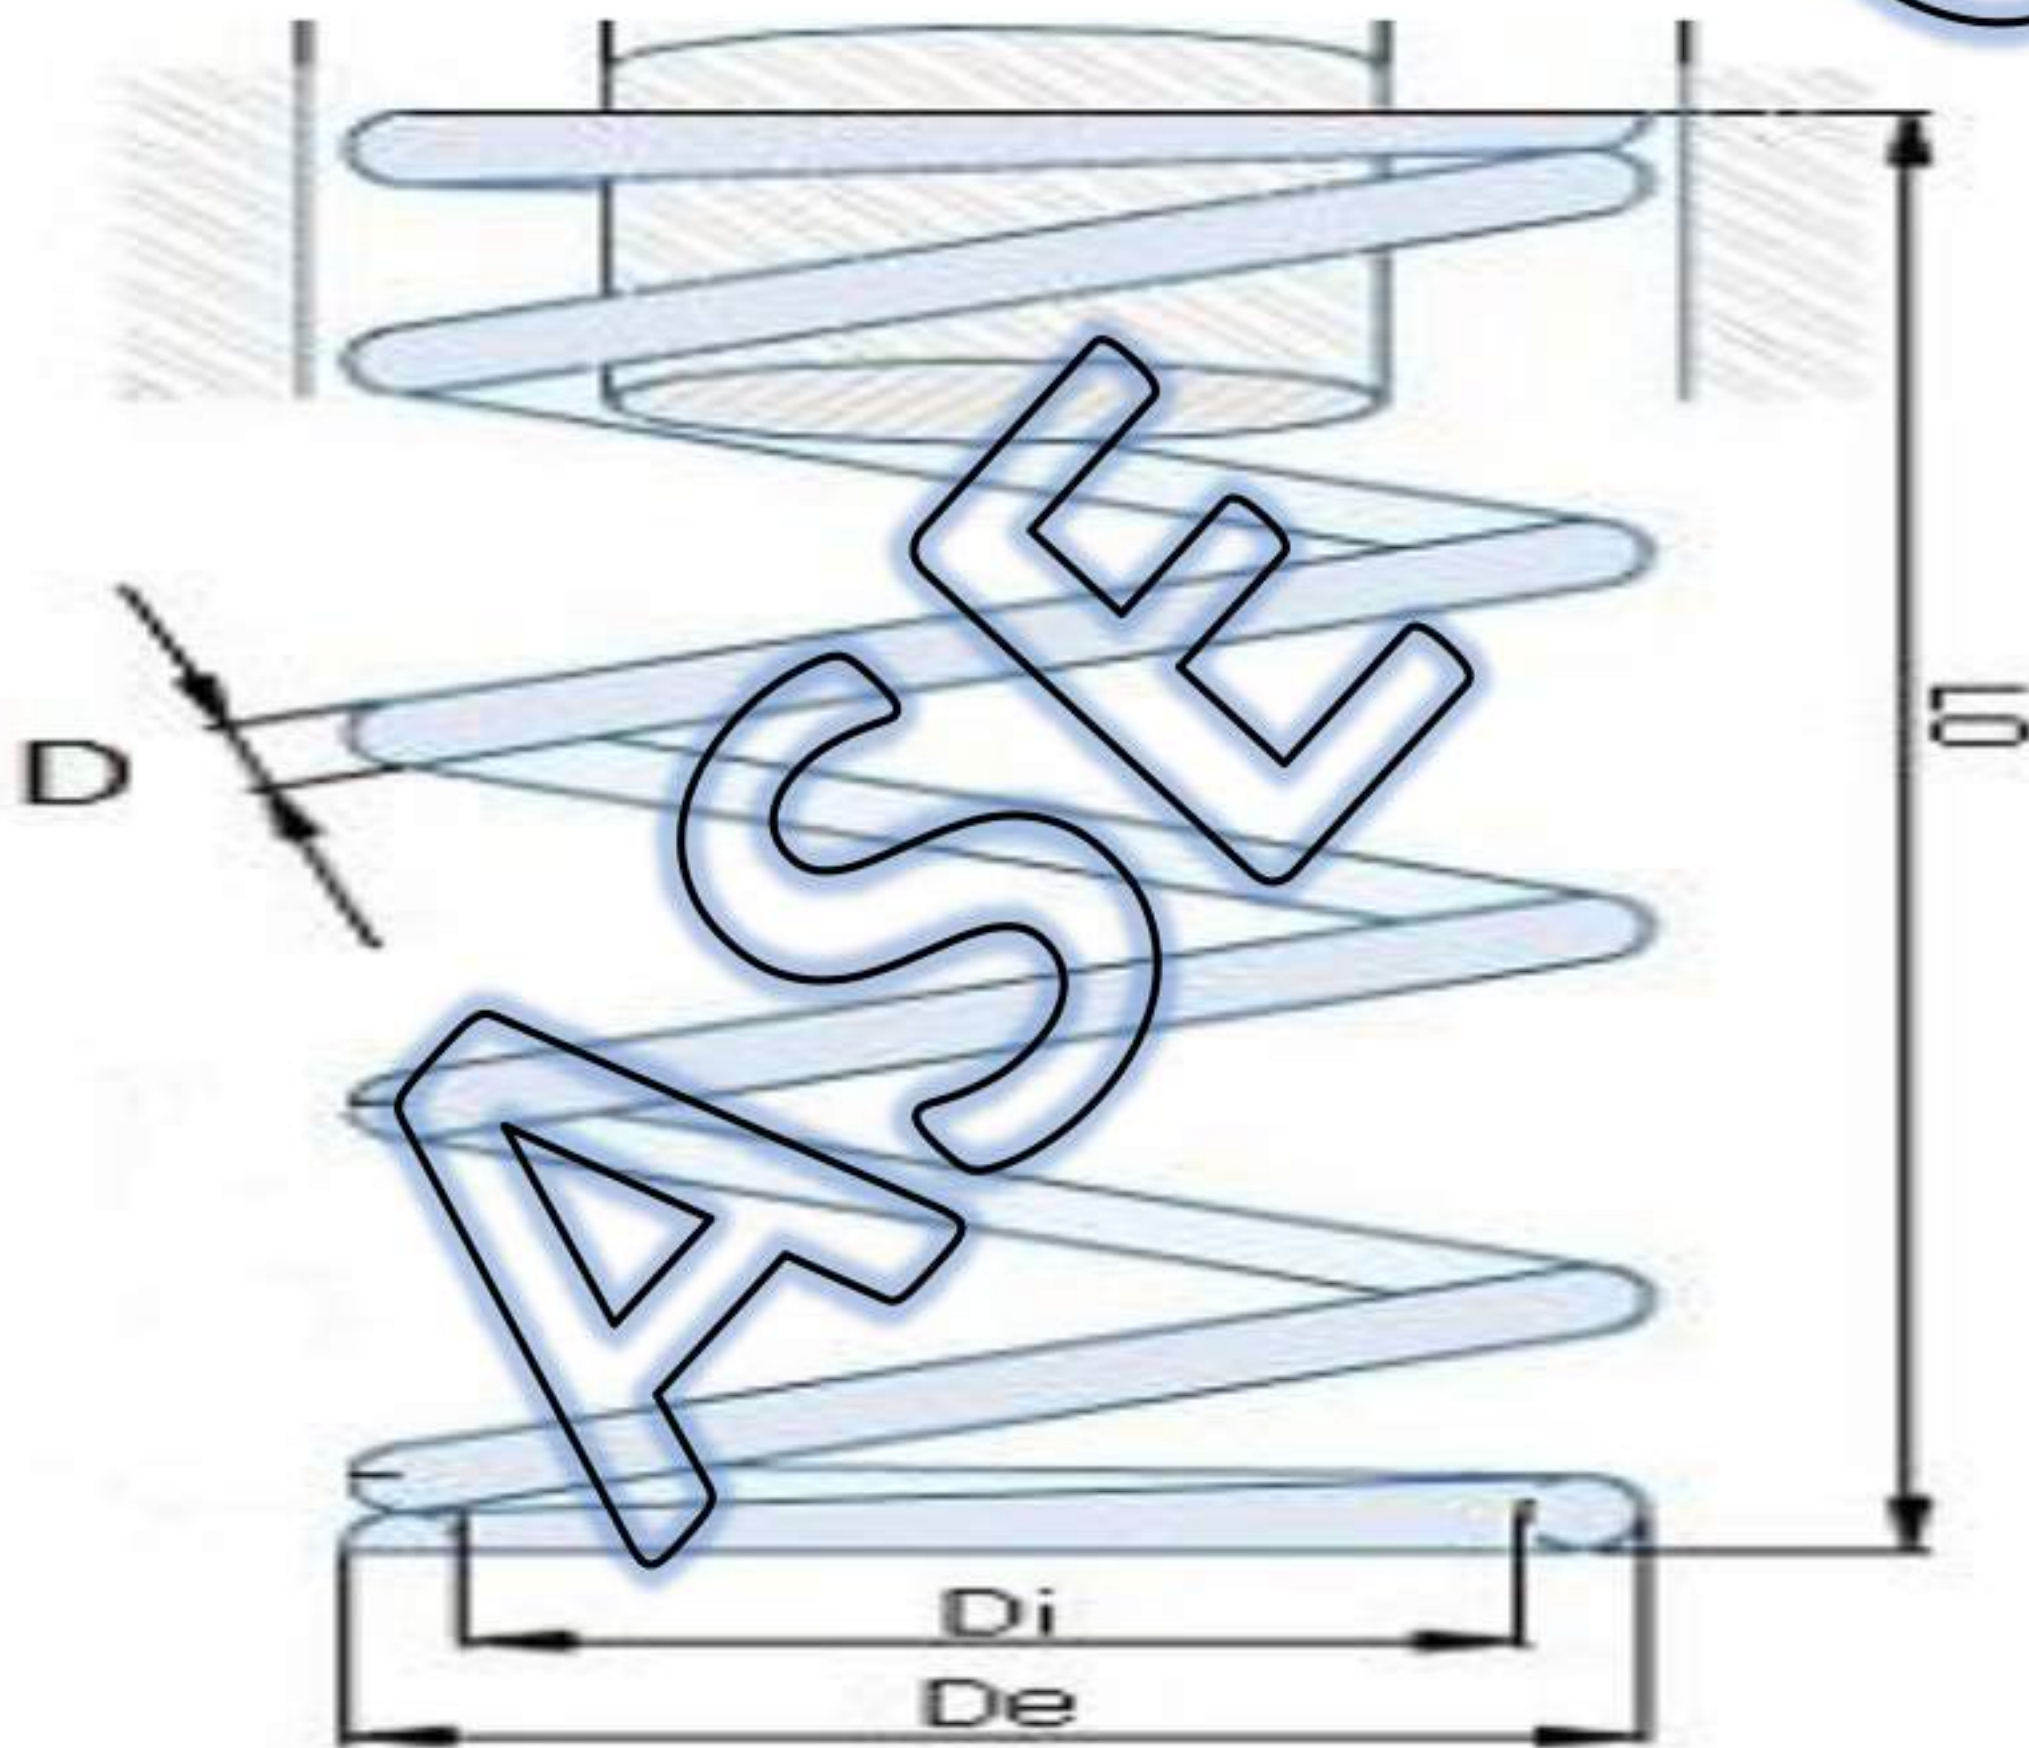

Length Adjustment screw

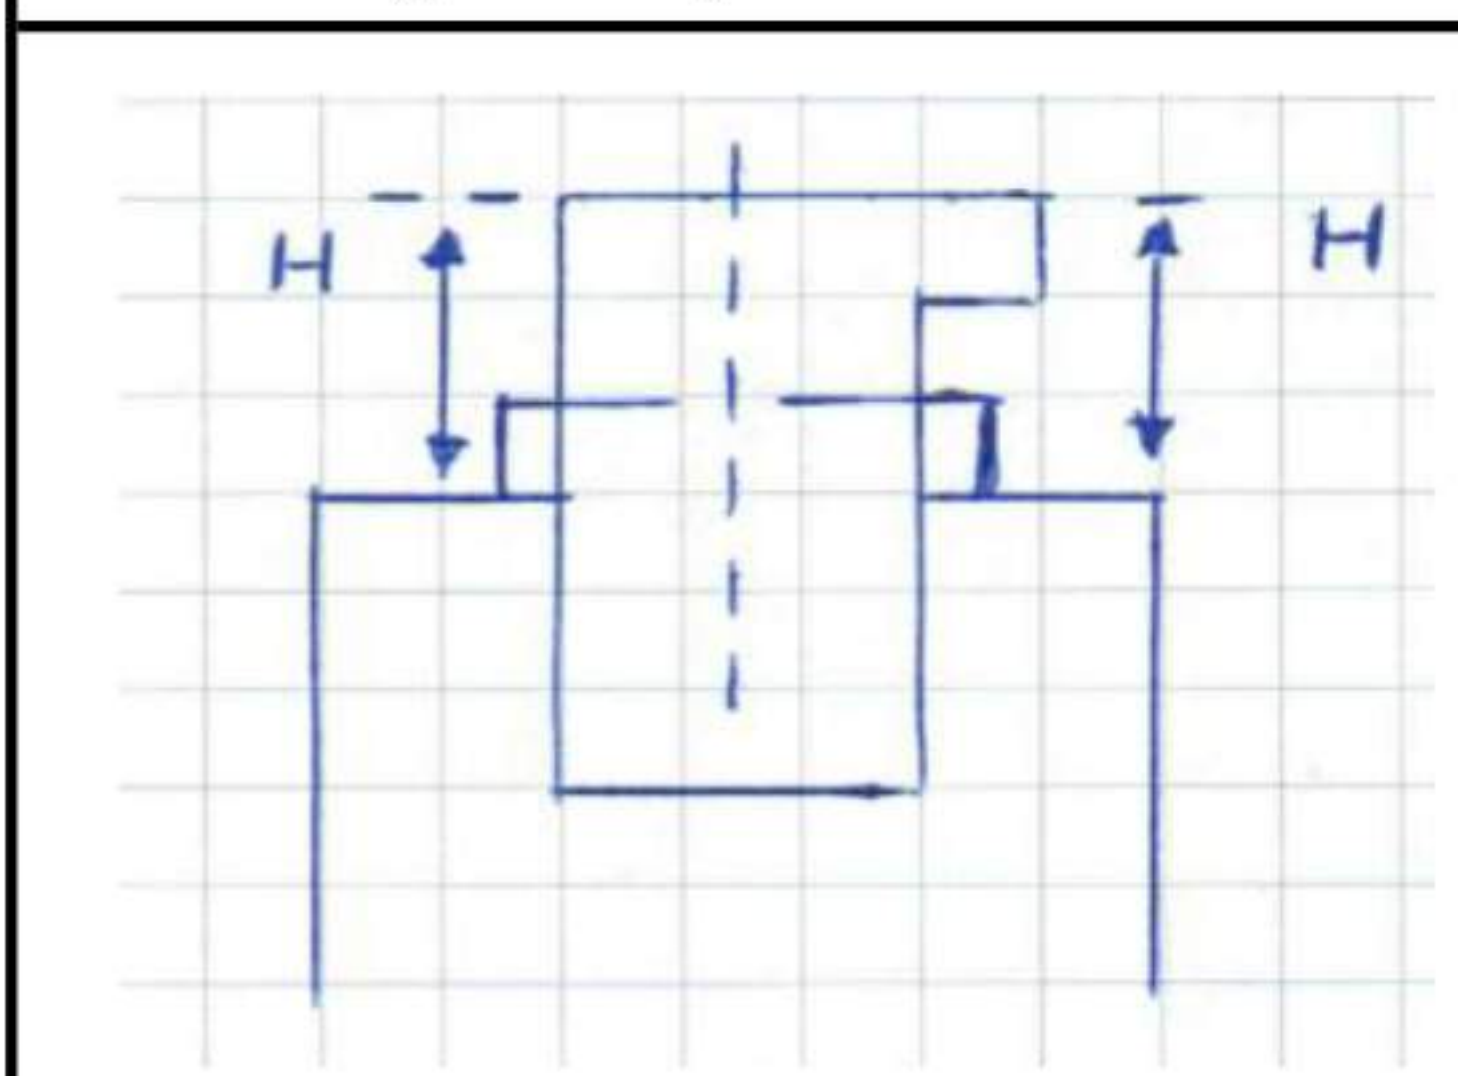

Blow Down Ring

Upper Ring	
Old	New
Lower Ring	
Old	New

Remarks	
Cleaned and degreased for oxygen service	N

The engineer, as signed, confirmed that the safety valve mentioned on this certificate is technical and functional checked according the original specification and tollerances of the manufacturer.

Tested by: _____ Final Inspection: _____

Date: 19-3-2020 Date: 19-3-2020